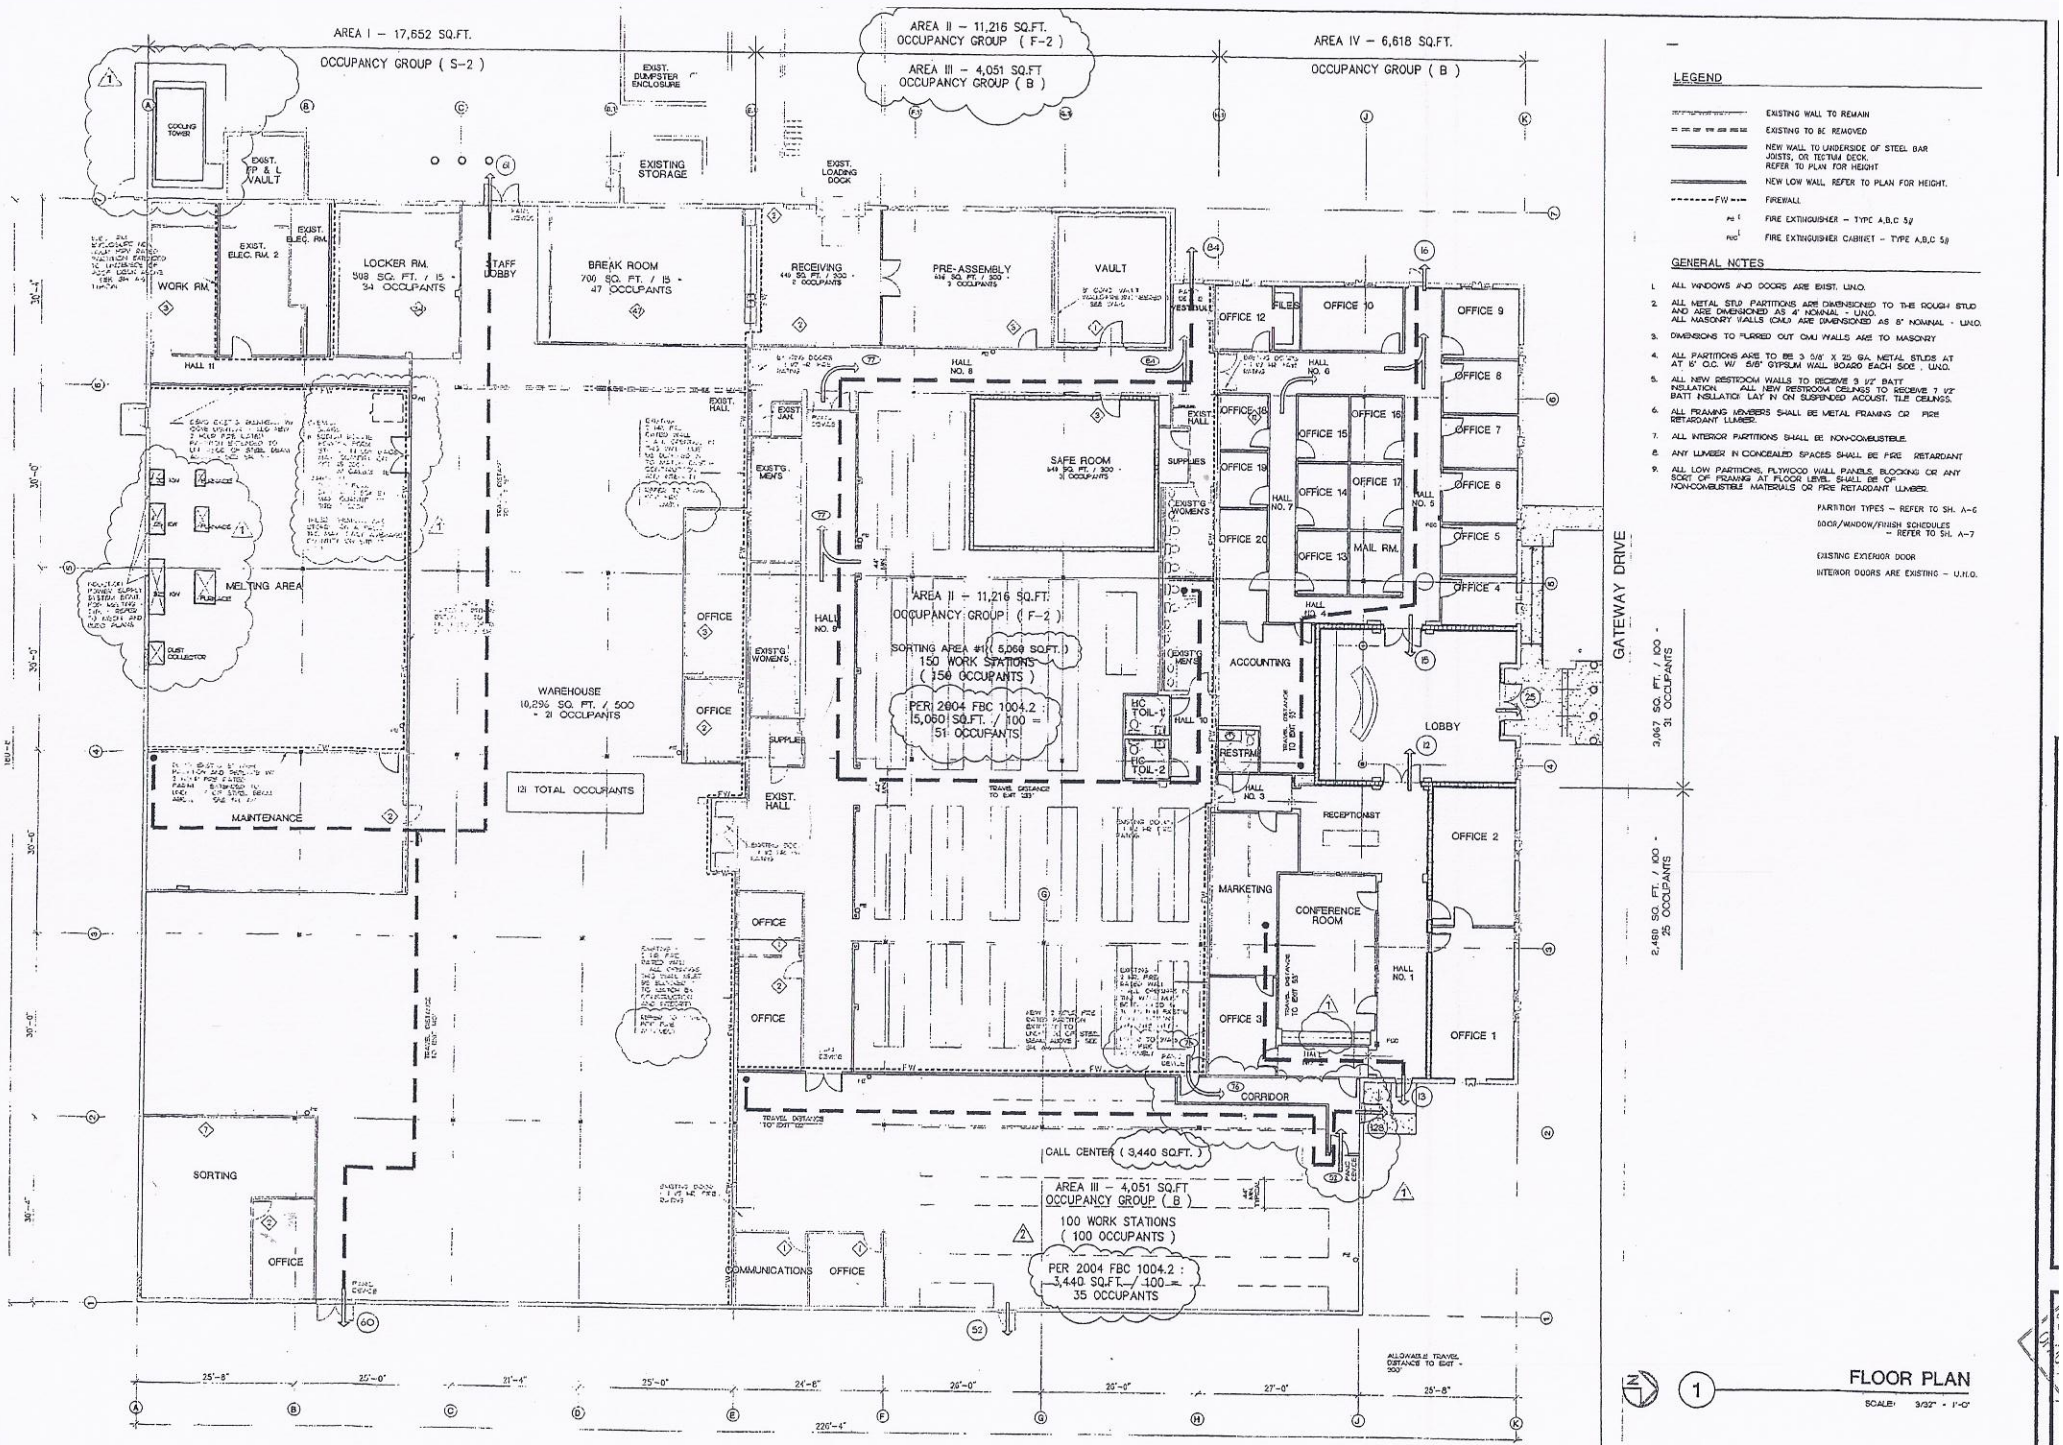

LEGEND

- EXISTING WALL TO REMAIN
- EXISTING TO BE REMOVED
- NEW WALL TO UNDERSIDE OF STEEL BAR JOISTS, OR TECTUM DECK. REFER TO PLAN FOR HEIGHT
- NEW LOW WALL. REFER TO PLAN FOR HEIGHT.
- FW — FIREWALL
- FE — FIRE EXTINGUISHER – TYPE A,B,C 5#
- FEC — FIRE EXTINGUISHER CABINET – TYPE A,B,C 5#

GENERAL NOTES

1. ALL WINDOWS AND DOORS ARE EXIST. U.N.O.
2. ALL METAL STUD PARTITIONS ARE DIMENSIONED TO THE ROUGH STUD AND ARE DIMENSIONED AS 4" NOMINAL - U.N.O. ALL MASONRY WALLS (CMU) ARE DIMENSIONED AS 8" NOMINAL - U.N.O.
3. DIMENSIONS TO FURRED OUT CMU WALLS ARE TO MASONRY
4. ALL PARTITIONS ARE TO BE 3 5/8" X 25 GA. METAL STUDS AT AT 6" O.C. W/ 5/8" GYPSUM WALL BOARD EACH SIDE , U.N.O.
5. ALL NEW RESTROOM WALLS TO RECEIVE 3 1/2" BATT INSULATION. ALL NEW RESTROOM CEILINGS TO RECEIVE 7 1/2" BATT INSULATION LAY IN OR SUSPENDED ACOUST. TILE CEILINGS.
6. ALL FRAMING MEMBERS SHALL BE METAL FRAMING OR FIRE RETARDANT LUMBER.
7. ALL INTERIOR PARTITIONS SHALL BE NON-COMBUSTIBLE.
8. ANY LUMBER IN CONCEALED SPACES SHALL BE FIRE RETARDANT
9. ALL LOW PARTITIONS, PLYWOOD WALL PANELS, BLOCKING OR ANY SORT OF FRAMING AT FLOOR LEVEL SHALL BE OF NON-COMBUSTIBLE MATERIALS OR FIRE RETARDANT LUMBER.

PARTITION TYPES – REFER TO SH. A-6

DOOR/WINDOW/FINISH SCHEDULES – REFER TO SH. A-7

EXISTING EXTERIOR DOOR

INTERIOR DOORS ARE EXISTING – U.N.O.

1 FLOOR PLAN

SCALE: 3/32" = 1'-0"